


METER LOOP	COPPER WIRE		CONDUIT		METER SOCKET & MAIN DISCONNECT	GROUND WIRE	
60 AMP METER LOOP	40'	#6 INSULATED (RH, RHH, RHW, THW, XHHW, THHW) STRANDED COPPER CONDUCTOR	10'	1" FLEX CONDUIT	100 AMP	5' #6 COPPER GROUND WIRE	

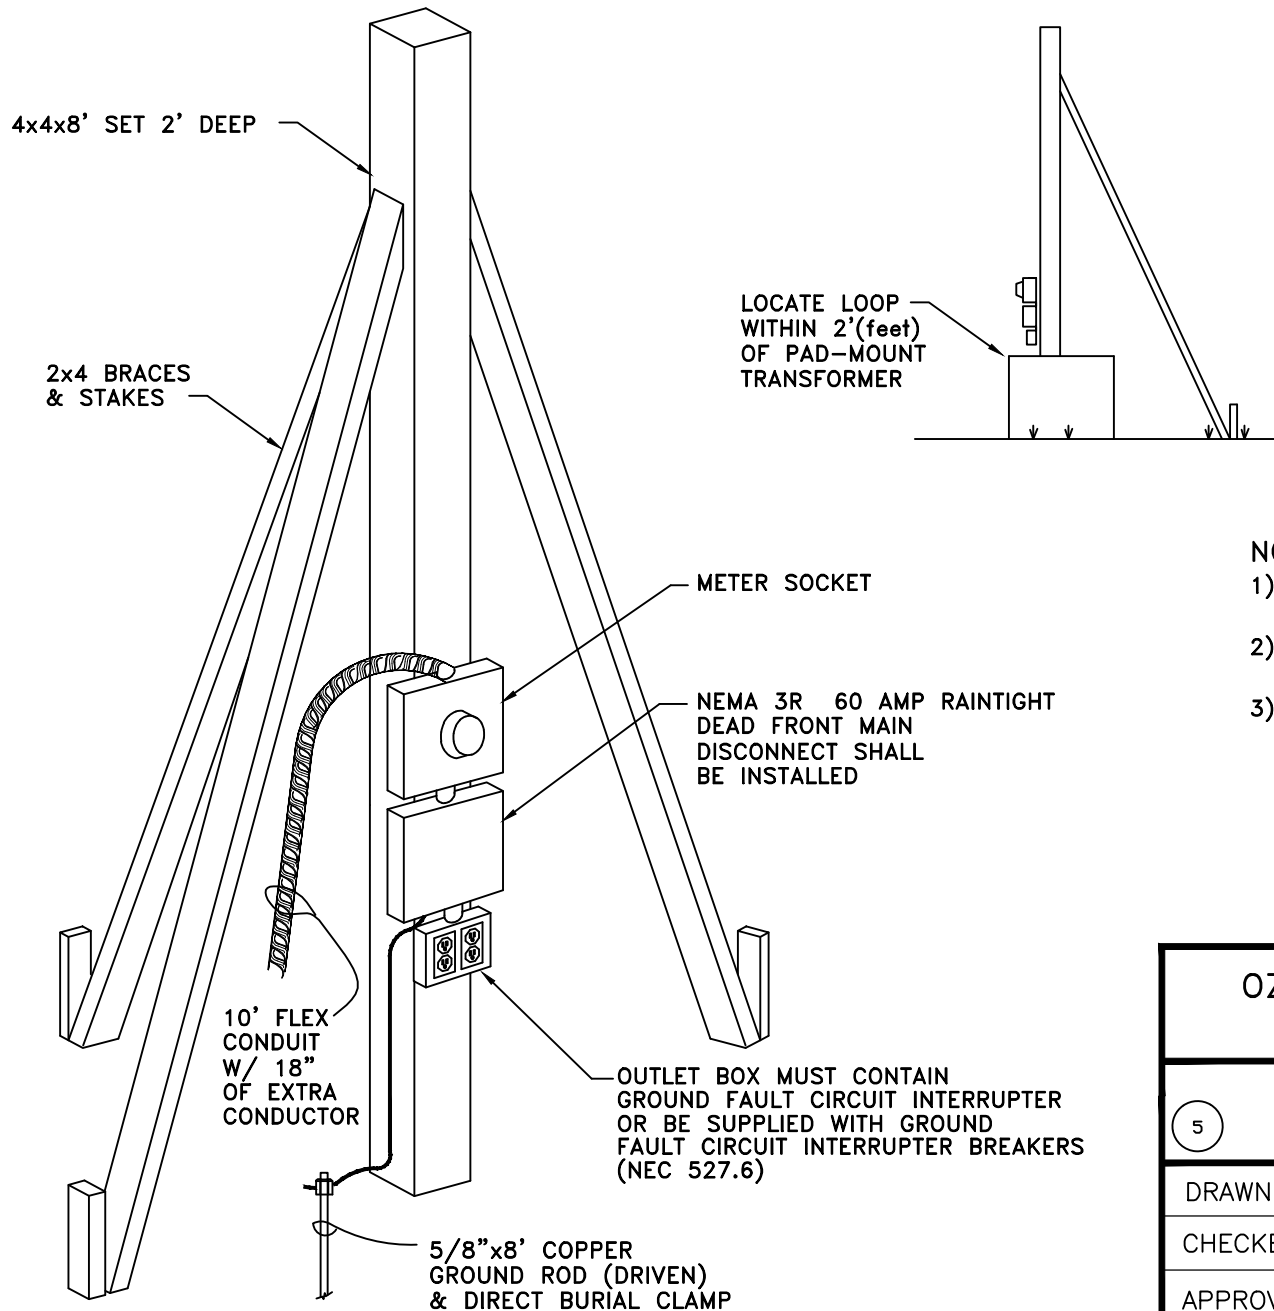

NOTES:

- 1) MEMBER MUST HAVE METER LOOP ASSEMBLED & STANDING.
- 2) LOOP MUST BE WITHIN 2' OF EXISTING PADMOUNT TRANSFORMER.
- 3) PERMANENT LOOP IS REQUIRED IF SERVICE IS TO BE CONNECTED FOR MORE THAN 6 MONTHS.

PUB.DATE: 08/01/12

OZARK ELECTRIC COOPERATIVE
MT. VERNON, MISSOURI

5 UNDERGROUND TEMPORARY
3 WIRE METER LOOP

DRAWN BY: DWB	DATE: 11/04/04
CHECKED BY: KMR	SCALE: NONE
APPROVED BY:	SPEC-SH/TEMP-LOOP