



**NOTE:**  
 OZARK ELECTRIC WILL FURNISH  
 SLIP JOINT, PIPE AND WIRE TO  
 CONSUMER SUPPLIED SWEEP.

**WARNING:**  
 IF WE CANNOT COMPLETE INSTALLATION  
 OF WIRE DUE TO INABILITY TO PULL  
 WIRE TO MAKE FINAL CONNECTIONS,  
 JOB WILL BE ABORTED UNTIL CHANGES  
 ARE MADE BY MEMBER.

**NOTE:**  
 DO NOT BRICK AROUND  
 METER BASE OR OVER  
 CONDUIT RISER. MUST  
 BE SURFACE MOUNTED.

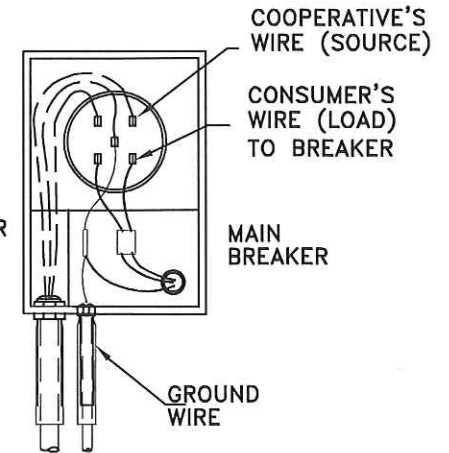


SEPARATE  
 RACEWAY FOR  
 COOP WIRES

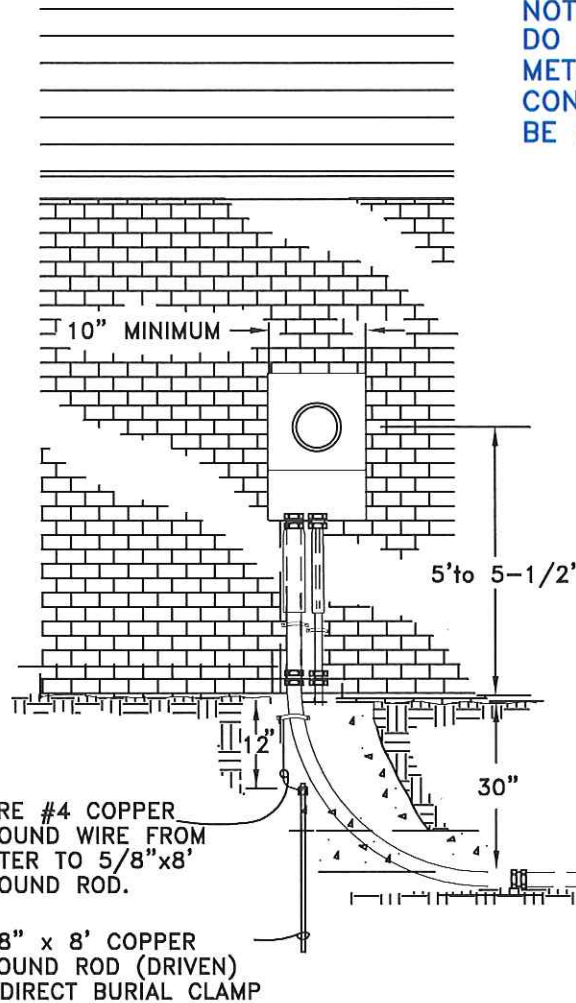

**NOTE:**  
 SERVICE PANEL CAN NOT BE  
 LOCATED IN BATHROOMS OR IN  
 VICINITY OF EASILY IGNITIBLE  
 MATERIALS SUCH AS CLOSETS.  
 (REF NEC ART 240-24)

**NOTE:**  
 CONDUIT RISER WILL BE  
 SECURELY ANCHORED BY NOT  
 LESS THAN 2 STRAPS WITH  
 THE LOWEST STRAP AT TOP  
 OF SWEEP.

**NOTE:**  
 Clearance from Conduit Sweep to  
 foundation footings must be  
 maintained so Sweep rests firmly  
 on the bottom of the trench.  
 The Conduit Sweep shall not be  
 altered in any way to  
 accommodate this clearance.  
 Sweep must maintain an  
 unaltered 36" radius.

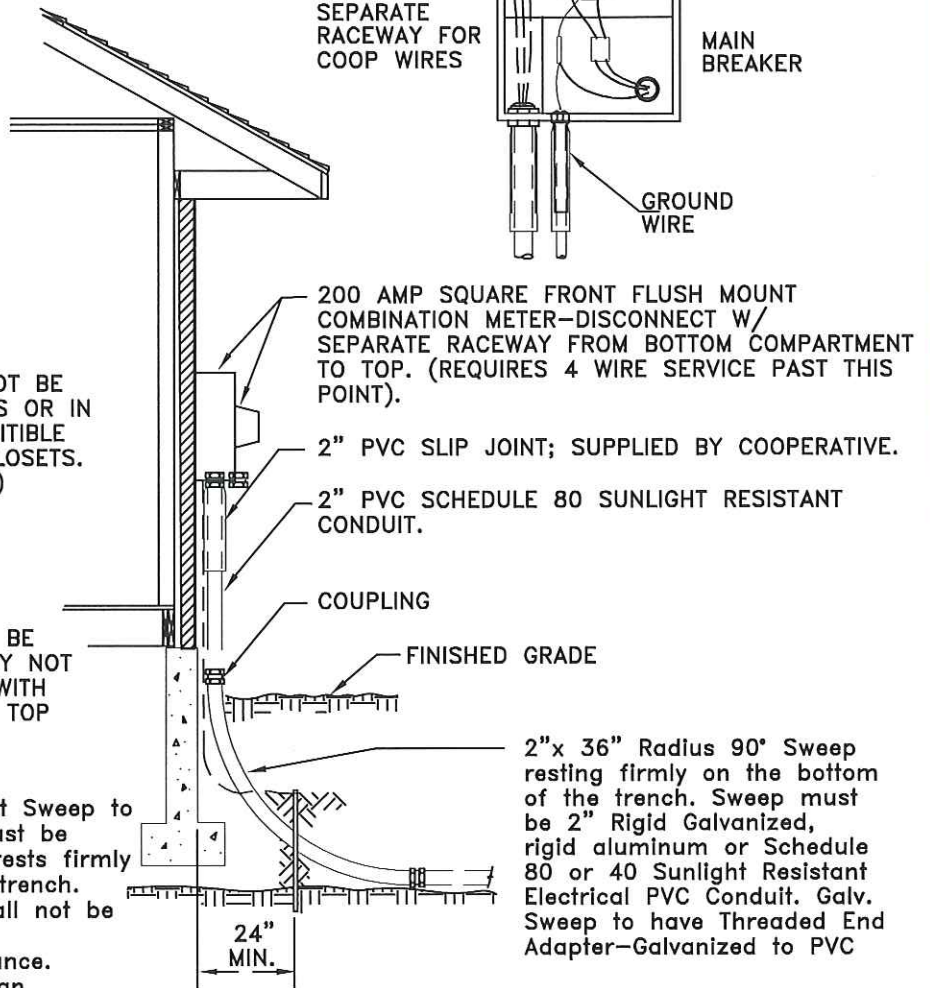

**SPECIFICATIONS  
 FOR  
 UNDERGROUND RESIDENTIAL SERVICE  
 METER BASE SURFACE MOUNTED**

**OZARK ELECTRIC COOPERATIVE  
 MT. VERNON, MISSOURI**

DRAWN BY: JM

DATE: 5/7/2015

CHECKED BY: KMR

SCALE: NONE

APPROVED BY:

SPEC-SH/UGS-SR-MT