


**NOTE:**

- 1) TRENCH FROM TRANSFORMER TO PEDESTAL MUST BE A MINIMUM OF 30" DEEP AND LESS THAN 150'. DRIVE GROUND ROD IN TRENCH BESIDE PEDESTAL.
- 2) FINAL GRADE SHALL NOT BE ABOVE "GRADE LINE" ON PEDESTAL. BOTTOM PANELS ON PEDESTAL MAY HAVE TO BE ACCESSED FOR FUTURE MAINTENANCE.

GROUND WIRE

100A MAIN - BARE #6 COPPER  
 200A MAIN - BARE #4 COPPER

BARE COPPER GROUND WIRE FROM METER TO 5/8"x8' COPPER GROUND ROD AND DIRECT BURIAL CLAMP

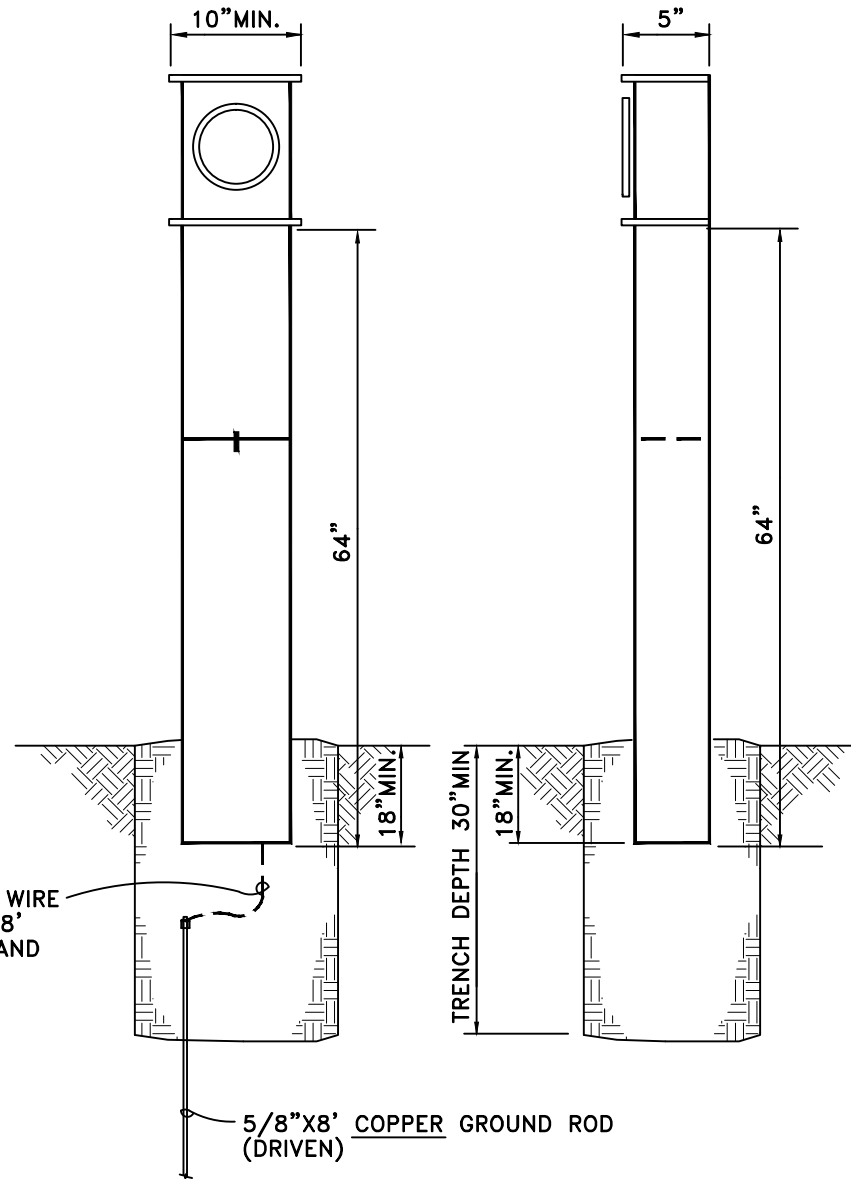

PUB.DATE: 08/01/12

SPECIFICATIONS  
 FOR  
 TROUGH TYPE  
 METER PEDESTAL

6 OZARK ELECTRIC COOPERATIVE  
 MT. VERNON, MISSOURI

DRAWN BY: DWB

DATE: 03/17/03

CHECKED BY: KMR

SCALE: NONE

APPROVED BY:

SPEC-SH/MTR-PED